

Single Point II Athletic Lockers meets tough standards

Single, Double, Triple & Four Tier, 4, 5 and 6 High Box



PART 1- GENERAL

1.1 RELATED DOCUMENTS:

We suggest use of your standard office reference to drawings, general and special conditions, etc.

1.2 SCOPE:

Furnish and install new steel lockers, accessories and finish metal trim as shown or indicated on approved drawings. Concrete or masonry bases, wood furring, blocking or trim as may be required by drawings are included in other sections of this specification.

1.2.1 SUBMITTALS:

Shop Drawings: Submit drawings showing locker types, sizes and quantities, including all necessary details relating to anchoring, trim installation and relationship to adjacent surfaces.

Numbering: The locker numbering sequence shall be provided by the approving authority and noted on the approved drawings returned to the locker contractor.

Color Charts: Provide color charts showing manufacturer's available colors. If required by normal office procedures or in the event of non-standard color selection, request samples of paint on metal.

Lock Combination Listings and Master Keys: Use only when combination locks are specified. Delivered directly to the owner's representative.

1.3 QUALITY ASSURANCE:

1.3.1 UNIFORMITY: Provide each type of metal locker as produced by a single manufacturer, including necessary accessories, fittings and fasteners.

1.3.2 JOB CONDITIONS: Do not deliver metal lockers until building is enclosed and ready for locker installation. Protect from damage during delivery, handling, storage and installation.

PART 2- PRODUCTS

2.1 MANUFACTURER:

Republic Storage Systems, LLC. Products by other manufacturers may be approved provided they meet the detailed specifications written below. Approval procedure shall be as specified in the General Conditions of these specifications.

2.2 LOCKERS:

Configuration:


- Single Tier Double Tier
 Triple Tier Four Tier Box

Size:

Color:

No. of Locker Frames:

No. of Locker Openings:

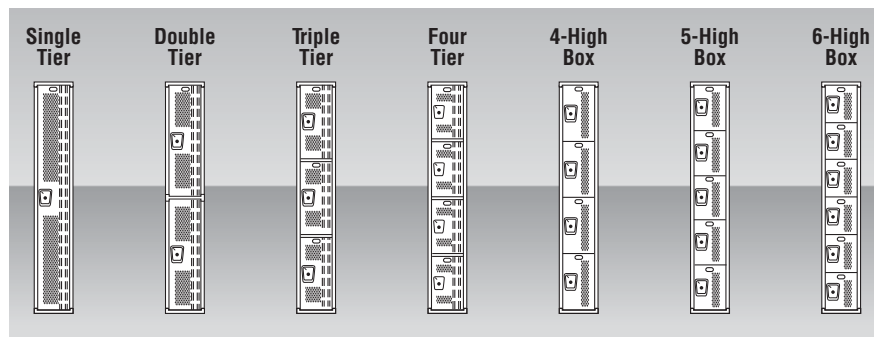

2.3 FABRICATION - GENERAL:

2.3.1 MATERIAL: All major steel parts shall be made of mild cold rolled steel, free from imperfections and capable of taking a high grade baked enamel or powder coat finish.

-ALTERNATE: Specified locker components shall be manufactured from Galvannealed steel and finished by manufacturer's standard process.



Single Point II Athletic Lockers meets tough standards

Single, Double, Triple & Four Tier, 4, 5 and 6 High Box

2.3.2 FINISH: Surfaces of the steel shall be thoroughly cleaned, phosphatized and prepared for baked enamel or powder coat finish in accordance with paint manufacturer's instructions.

2.3.3 CONSTRUCTION: Lockers shall be built on the unit principle- each locker shall have an individual door and frame, an individual top, bottom, back and shelves with common intermediate uprights separating units. Assembly of all locker components shall be by riveting with a backup washer to provide a shake-proof permanent fastening system while still permitting fastener removal by drilling to allow future rearrangement of lockers or replacement of damaged parts.

-OPTION: Keps nuts and bolts may be used for assembly.

-ALTERNATE: All Welded Ventilated Lockers: Lockers shall be pre-assembled of welded construction in multiple groups conforming to job requirements. All welds shall be smooth and without burrs. No nuts, bolts, or rivets shall be allowed in the assembly of main locker groups

2.3.4 DOOR FRAMES: shall be 16 gauge formed into 1" wide face channel shapes with a continuous vertical door strike integral with the frame on both sides of the door opening. Cross frame members of 16 gauge channel shapes, including intermediate cross frame on double, triple and four tier lockers shall be securely welded to vertical framing members to ensure a square and rigid assembly. Intermediate cross frame members not required on box lockers.

2.3.5 DOORS: Construction shall be a single piece 14 gauge outer door with double return flanges on both vertical edges and a single return flange on the top and bottom edges. Doors on tiered lockers shall be reinforced with a full height 16 gauge channel reinforcement. Doors for tiered lockers shall have diamond shaped perforations 3/4" wide by 1 1/2" high to provide free air flow while leaving sufficient metal for rigidity and strength. Doors for box lockers 4, 5 and 6 openings high are perforated for free airflow using small diamond perforations 7/16" wide by 15/16" high. Doors shall be punched for the number plate mounting on the top face of the door.

2.3.6 LATCHING: Latching shall be achieved by securing an 11 gauge frame hook to the locker side frame located midway up the door. Lockers shall be equipped to accept both padlocks and built-in locks. There shall be a padlock hasp on the frame hook protruding through the stainless steel recessed pocket. There shall also be provision for a Master Lock

1690 or equivalent rotating cam lock to mount in the stainless steel recessed pocket and engage the frame hook.

2.3.7 HANDLES: A one piece, deep drawn stainless steel cup shall be securely riveted to the door to form a receptacle for the padlock or built-in lock. The pocket shall also have a formation across the top that provides a door pull. This stainless steel pocket shall contain a recessed area for the various lock types. gauge steel, set close in and welded to the frame. Continuous vertical door strike shall protect frame hooks from door slam damage. A soft rubber silencer shall be securely installed on each frame hook to absorb the impact caused by closing of the door.

2.3.8 HINGES: Hinges shall be 2" high, 5-knuckle, full loop, tight pin style, securely welded to frame and double riveted to the inside of the door flange. Locker doors 42" high and less shall have two hinges. Doors over 42" shall have three hinges.

2.3.9 BODY: Locker body components shall be made of cold rolled steel specially formed for added strength and rigidity and ensure tight joints at fastening points. 16 gauge side uprights are perforated with diamond-shaped openings 3/4" wide by 1 1/2" high for maximum ventilation. Locker backs shall be 18 gauge steel with right angle flanges on each vertical side for stiffness, ease of assembly, and to provide corner rigidity. Tops, bottoms, shelves and compartment dividers shall be 16 gauge steel, fully flanged on all sides for added stiffness. Shelves shall have an additional return flange on the front edge creating a channel shape to rigidize the impact surface. All body parts are finished in the same color selected for doors and frames.

-ALTERNATE: All Welded Ventilated Lockers: Locker back shall be fabricated from 16 gauge cold rolled sheet steel and formed in combination with the 16 gauge upright to provide a one-piece uniform structure.

2.3.10 INTERIOR EQUIPMENT: Single tier lockers over 42" high shall have one hat/book shelf. Other tiered lockers do not require shelves. All single, double and triple tier lockers shall have one double prong rear hook and two single prong side hooks in each compartment. All hooks shall be made of steel, formed with ball points, zinc-plated and attached with two bolts and or rivets. Locker openings under 20" high are not equipped with hooks.

2.3.11 NUMBER PLATES: Each locker shall have a polished aluminum number plate with black numerals not less than 1/2" high. Plates shall be attached with rivets to the top face of the locker door for high visibility.

2.3.12 COLOR: Doors and exposed body parts shall be finished in colors selected from Republic's collection of twenty-five baked enamel colors. Non-exposed body parts shall be finished in #83 Decorator Tan (baked enamel).

-ALTERNATE: Doors and exposed body parts shall be finished in colors selected from Republic's collection of nine powder coat colors. Non-exposed body parts shall be finished in #83 Decorator Tan (baked enamel).

-ALTERNATE: Entire locker shall be finished in colors selected from Republic's collection of nine powder coat colors.

-OPTION: Specifier may modify above paragraph if non-standard custom colors are selected.

2.3.13 ASSEMBLY: Assembly of all locker components shall be accomplished by the use of zinc plated, low round head, slotless, fin neck machine screws with Keps nuts, producing a strong mechanical connection.

PART 3 - EXECUTION

3.1 INSTALLATION:

Lockers must be installed in accordance with manufacturer's approved drawings and installation instructions. Installation shall be level and plumb with flush surfaces and rigid attachment to anchoring surfaces. Space fasteners at 36" O.C. or less as recommended by manufacturer. Use fasteners appropriate to load and anchoring substratum. Use reinforcing plates wherever fasteners could distort metal. Various trim accessories where shown such as sloping tops, fillers, bases, recess trim, etc., shall be installed using concealed fasteners. Flush, hairline joints are provided at all abutting trim parts and at adjoining surfaces.

3.2 ADJUSTMENT:

Upon completion of installation, inspect lockers and adjust as necessary for proper door and locking mechanism operation.

3.3 QUALITY ASSURANCE:

Republic reserves the right to modify the design and/or change specifications or colors/finish consistent with our policy of product excellence.

NOTE: For user safety, all Republic lockers must be secured to the wall and/or floor prior to use.

